
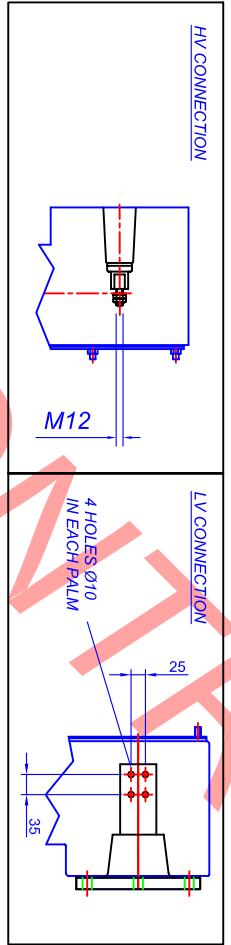



ITEM	DESCRIPTION
1	HV CABLE BOX 3 POLE 1 GLAND (TERMINATION KIT READ)
2	LV CABLE BOX 4 POLE 4 GLAND AIR FILLED
3	TRANSFORMER OIL FILLER COVER
4	THERMOMETER POCKET
5	LIQUID LEVEL GAUGE
6	EARTHING TERMINAL ONE EACH SIDE
7	SKID UNDERBASE C/W HAULAGE HOLES
8	MAIN LIFTERS
9	BREATHER PIPE C/W SILICA GEL BREATHER SUPPLIED LOOSE
10	TAPPING SELECTOR CONTROL HANDLE
11	RATING AND DIAGRAM PLATE
12	DRAIN VALVE
13	
14	RADIATOR

BOWERS JOB NO.	
BOWERS STOCK NO.	200 kVA
OUTPUT	11000 / 433
VOLTAGE RATIO	10.5 / 267
AMPERES	3
PHASES	50Hz
FREQUENCY	Dyn11
VECTOR SYMBOL	
ESTIMATED WEIGHTS	KG
CORE AND WINDINGS	652
COOLING LIQUID 326 LTRS	320
TOTAL WEIGHT	1305

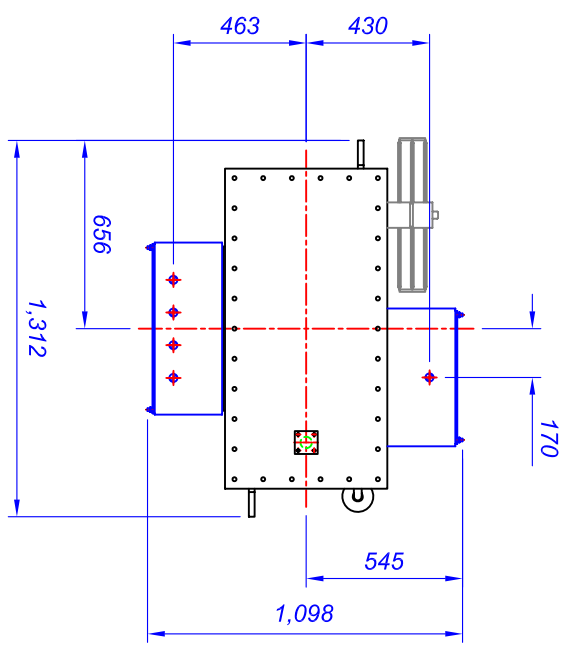

This drawing is COPYRIGHT and the property of Bowers Electricals Ltd. It must not be copied, in whole or in part, without prior written consent of the company.

TOLERANCE UNLESS OTHERWISE STATED:
 ± 0.5mm FOR DIMENSIONS UP TO 200mm
 ± 0.2mm FOR DIMENSIONS OVER 200mm
 ± 0.20mm FOR DIMENSIONS OVER 1000mm

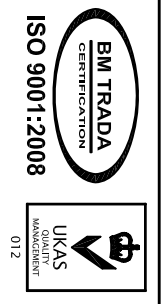

Rev	Revision note	Date	Signed	Checked

Bowers Electricals Ltd
 Headof Gate Road,
 Headof, Derbyshire, DE75 7GX
 Tel: 01773 531531 Fax: 01773 716171
 E-mail: enquiries@bowerselec.co.uk

Drawn by C.MEISE
 Checked by D.NESBITT
 GENERAL ARRANGEMENT
 OF 200KVA KVAN
 TRANSFORMER

Approved by AS	Orig. Job No. TR61492	Date 28/03/11	Drq. Size A3
DRG No. BE5292		Scale 1:20	Revision 0
FIRST ANGLE		Sheet 1/1	